

# P SERIES



## SELECTION

Line-up includes a selection of eight indoor units and four series of outdoor units. Easily construct a system that best matches room air conditioning needs.

R32 INDOOR UNIT		R32 OUTDOOR UNIT	
		Power Inverter	Standard Inverter
4-way ceiling-cassette PLA-ZM EA PLA-M EA	Wall-mounted PKA-M LA(L) PKA-M KA(L)	PUZ-ZM35/50	SUZ-M35
Ceiling-concealed PEAD-M	Ceiling-concealed PEA-M	PUZ-ZM60/71	SUZ-M50
Ceiling-suspended PCA-M	Floor-standing PSA-M	PUZ-ZM100/125/140/ 200/250	SUZ-M60/71
Professional Kitchen PCA-M HA			PUZ-M100/125/140
			PUZ-M200/250

\* Some indoor units cannot be used with this unit.

R410A INDOOR UNIT		R410A OUTDOOR UNIT	
		Power Inverter	Standard Inverter
4-way ceiling-cassette PLA-ZM EA PLA-M EA	Wall-mounted PKA-M LA(L) PKA-M KA(L)	PUHZ-ZRP35/50	SUZ-KA35
Ceiling-concealed PEAD-M	Floor-standing PSA-M	PUHZ-ZRP60/71	SUZ-KA50/60/71
Ceiling-suspended PCA-M	Ceiling-concealed PEA-M	PUHZ-ZRP100/125/140/ 200/250	PUHZ-P100/125/140
Professional Kitchen PCA-M HA			PUHZ-P200/250

\* Some indoor units cannot be used with this unit.

To confirm compatibility with the MXZ Series, refer to the MXZ Series page.

## SELECT COMBINATION

Choose the installation pattern for the indoor units. (In the case of a multi-system, distribution piping is necessary, so please select the necessary piping as well.)

<p><b>Single System</b></p>	<p><b>Simultaneous Multi-System</b></p> <p><b>Twin</b> Allows simultaneous operation of two indoor units on one floor.</p>	<p><b>Quadruple</b> Realises the optimum temperature distribution even in a large space.</p>
	<p><b>Triple</b> Can cover a large-scale space or dispersed installation on the same floor.</p>	


### Connectable Combinations for Inverter Units

Outdoor Unit Capacity	Indoor Unit Capacity		
	Twin	Triple	Quadruple
71	50 : 50 35 × 2	33 : 33 : 33	25 : 25 : 25 : 25
100	50 × 2	—	—
125	60 × 2	—	—
140	71 × 2	50 × 3	—
200	100 × 2	60 × 3	50 × 4
250	125 × 2	71 × 3	60 × 4
Distribution Pipe	MSDD-50TR-E MSDD-50WR-E MSDD-50TR2-E2 MSDD-50WR2-E	MSDT-111R-E MSDT-111R3-E	MSDF-1111R-E MSDF-1111R2-E

Note: The distribution pipe listed is required for simultaneous multi-systems.


# Power Inverter SERIES

Our Eco-conscious Power Inverter Series is designed to achieve industry-leading seasonal chery-eficiency throught use of New R32 refrigerant and advanced technologies.

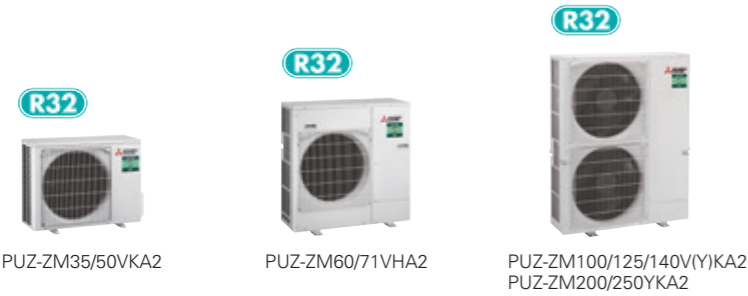

## Industry-leading energy efficiency


Introduction of new R32 refrigerant realises improved cooling efficiency. Rating of more than 7.0 achieved for all capacity range.

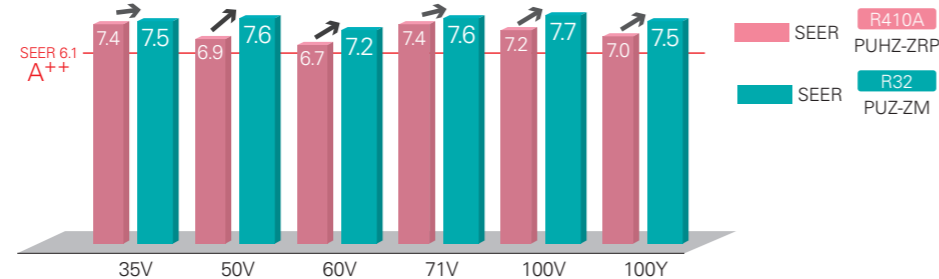

Introduction of new R32 refrigerant reduces energy consumption and realises energy savings.

## Longer piping (60/71/100/125/140/200/250)


Longer piping length realised for 60, 71, 100, 125, 140, 200 and 250 classes, widely increasing installation flexibility.

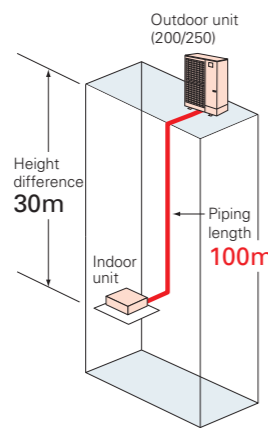

	Piping Length	
	R410A PUHZ-ZRP	R32 PUZ-ZM
35/50	50m	50m
60/71	50m	55m
100/125/140	75m	100m
200/250	100m	100m

## Rated heating capacity maintained down to -3°C\*

Rated heating capacity maintained even when the outside temperature is down to -3°C. Stay warm even at times of cold weather.

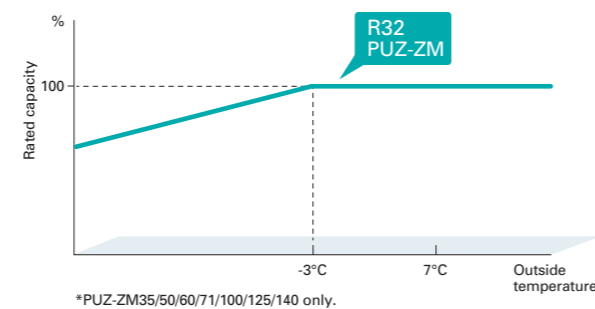


## 2+1 Back-up rotation\*

The use of a three-refrigerant air conditioning system enables you to utilize the back-up, rotation, and cut-in functions. This allows you to implement effective risk management for added peace of mind.

\*Availability of this function is depending on outdoor unit, indoor unit and remote controller.


### Back-up Function

In the unlikely event that one of the units stops operation due to an abnormality, the standby unit immediately starts back-up operation. Being fully prepared for a failure guarantees that and operation is always available and gives you the confidence that your system will be reliable in any situation.

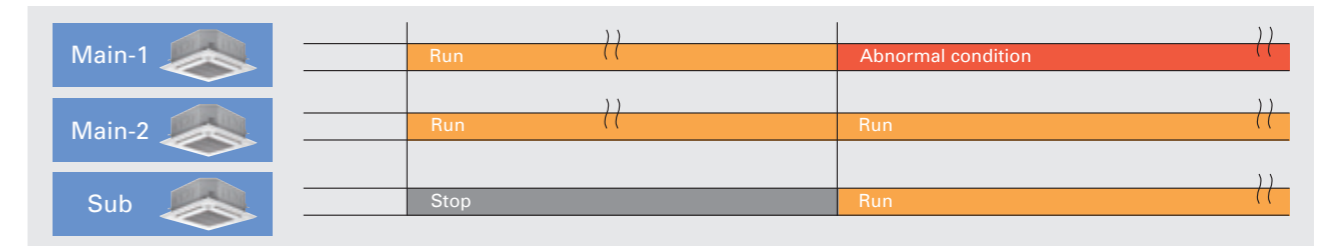


### Rotation Function

A single remote controller is used to operate three-refrigerant air conditioning system in a rotation pattern. Reducing the burden on the equipment allows you to maintain a longer time between maintenance and increases product life.

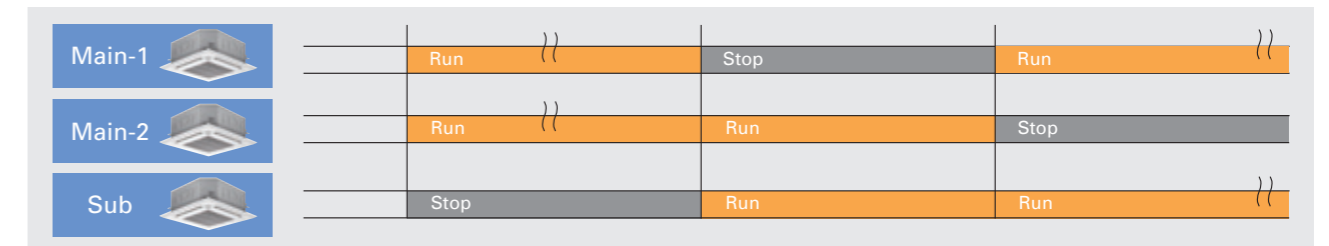

### Cut-in Function


If the actual room temperature greatly differs from the set temperature and two-refrigerant air conditioning system is insufficient, the standby unit starts operation to provide support.

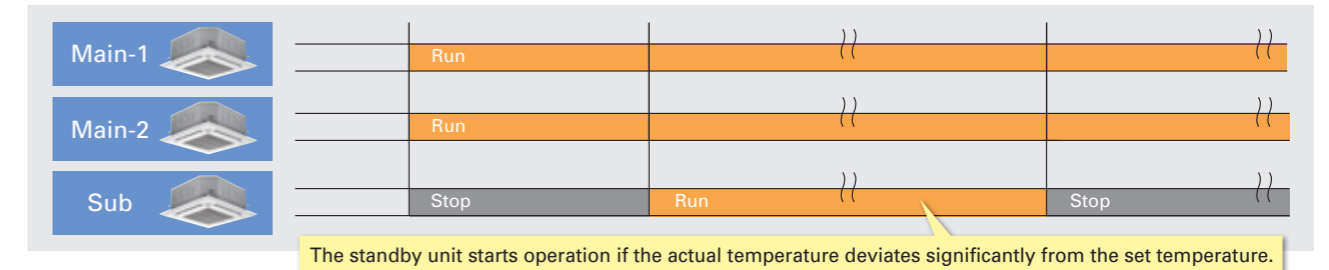

## Extended cooling set temperature range\*

In environments such as gyms where people do strenuous exercise, even if the room is cooled to an appropriate temperature, people may feel that it is hot, and they need a cooler air. To satisfy such demands, we have extended the lower limit of the cooling set temperature range from 19-30°C. to 14-30°C.

\*Insulation kit (PAC-SK36HK-E) is required when indoor unit is PLA series.  
\*Availability of this function is depending on outdoor unit, indoor unit and remote controller.

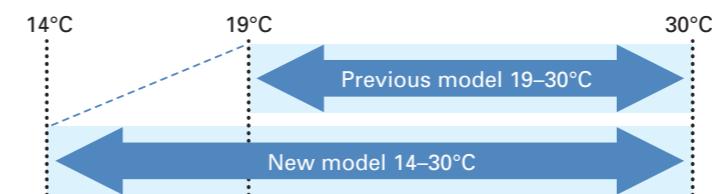

## Display of model names and serial numbers\*

The model names and serial numbers of the indoor/outdoor units that are connected to the MA smart remote controller can be automatically acquired and displayed through one simple operation. This eliminates the need to directly check each unit and helps with inquiries in the case of an abnormality.

\*Availability of this function is depending on outdoor unit, indoor unit and remote controller.

● Model name display (example)

```
Collect model names and S/N
OU PUZ-ZM200YKA2
IU1 PLA-ZM50EA2
IU2 PLA-ZM50EA2
IU3 PLA-ZM50EA2
IU4 PLA-ZM50EA2
Collect data: ✓
- Address + S/N
```

● Serial number display (example)

```
Collect model names and S/N
OU 1ZU0001
IU1 1ZA0001
IU2 1ZA0002
IU3 1ZA0003
IU4 1ZA0004
Collect data: ✓
- Address + Model
```

## Preliminary error history\*

In addition to error history, the history of preliminary abnormalities can be displayed. The feature enables the unit status check during inspection and maintenance.

\*Availability of this function is depending on outdoor unit, indoor unit and remote controller.

### ●Error history (Sample)

Error history		1/4
Error	Unt# dd/mm/yy	
E0	0-1 21/10/20 PM12:34	
E0	0-1 20/12/20 AM 1:23	
E0	0-1 20/11/20 PM10:55	
E0	0-1 20/10/20 PM12:01	

Error history menu: Page Delete

### ●Preliminary error history (Sample)

Preliminary error hist.		1/8
Error	Unt# dd/mm/yy	
E0	0-1 21/10/20 PM12:34	
E0	0-1 20/12/20 AM 1:23	
E0	0-1 20/11/20 PM10:55	
E0	0-1 20/10/20 PM12:01	

Error history menu: Page Delete

## Display of power consumption\*

It is possible to measure, acquire, and display the amount of energy used by each air conditioning system.

\*Availability of this function is depending on outdoor unit, indoor unit and remote controller.

< Data Collection Period >

Time data: Every 30 minutes over the past month

Monthly/daily data: Monthly over the past 14 months

Energy consumption values are calculated from estimated power consumption values according to the operating conditions. They may vary from the actual power consumption values. Please note that the power consumption of optional parts is not included except in the case of optional parts that have their power supplied directly by the outdoor unit.

### ●Every 30 minutes (example)

Energy data		1/6
2019-1-1	1234.5kWh	
0:30	123.4kWh	2:30 123.4kWh
1:00	123.4kWh	3:00 123.4kWh
1:30	123.4kWh	3:30 123.4kWh
2:00	123.4kWh	4:00 123.4kWh

Return: Date Page

### ●Daily (example)

Energy data		1/4
2019-1	123456.7kWh	
31	1234.5kWh	27 1234.5kWh
30	1234.5kWh	26 1234.5kWh
29	1234.5kWh	25 1234.5kWh
28	1234.5kWh	24 1234.5kWh

Return: Page

### ●Monthly (example)

Energy data		1/3
▶2019-1	123456.7kWh	
2018-12	123456.7kWh	
2018-11	123456.7kWh	
2018-10	123456.7kWh	
2018-9	123456.7kWh	

View daily data: Cursor


## Improved defrosting performance\*

\*Availability of this function is depending on outdoor unit, indoor unit and remote controller.

### Avoiding Simultaneous Defrosting


When each of multiple units is in operation for heating in the same space, these may start defrosting at the same time, resulting in a drop in the room temperature. Therefore, we have developed a new function that controls up to four-refrigerant air conditioning system to avoid simultaneous defrosting. By ensuring that defrosting is only performed by one unit at a time, it is possible to minimize any decrease in room temperature.

Example System Configuration  
Four sets controlled by a single remote controller

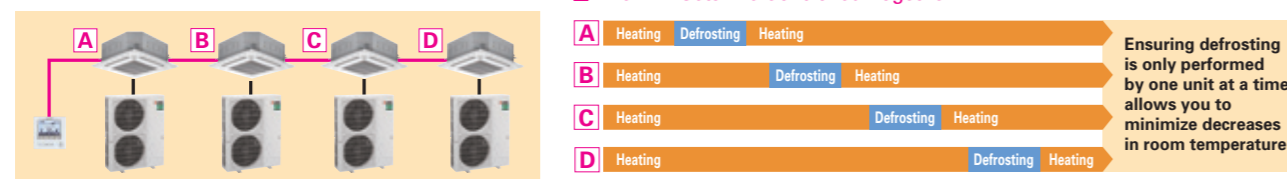


### Defrosting When People Are Absent

The use of the 3D i-see sensor allows a more comfortable defrosting schedule. After a large amount of frost has built up, the system will switch to defrosting when the 3D i-see sensor detects that no people are present. By minimizing defrosting while people are in the room, there is a much lower chance of a temperature drop while the room is occupied.

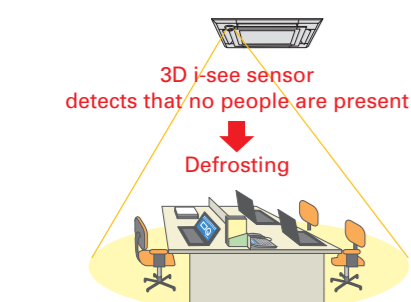

### Defrosting When Operation is Stopped

It takes a long time to start operation if there is an excess build-up of frost. Therefore, each unit is equipped with a control system where defrosting is performed immediately after operation is stopped when there is a large amount of frost. This allows heating to be quickly started the next day.

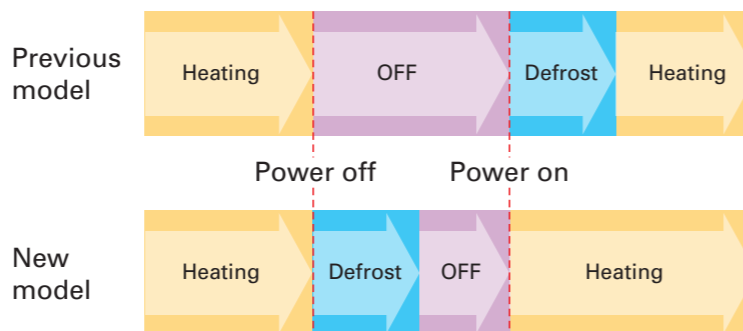


The power turns off after defrosting is complete and the system will start up smoothly the next time it is used.

\* Only compatible with 4-way cassette and 2x2 cassette models with an attached 3D i-see sensor panel. Even though people are present in the room, the defrosting process may start if all defrosting conditions are met.

## Easier M-NET Adapter Installation

The optional M-NET adapter, which allows centralized control (M-NET control), is now easier to install. The redesigned mounting position significantly reduces the time and effort for installation.

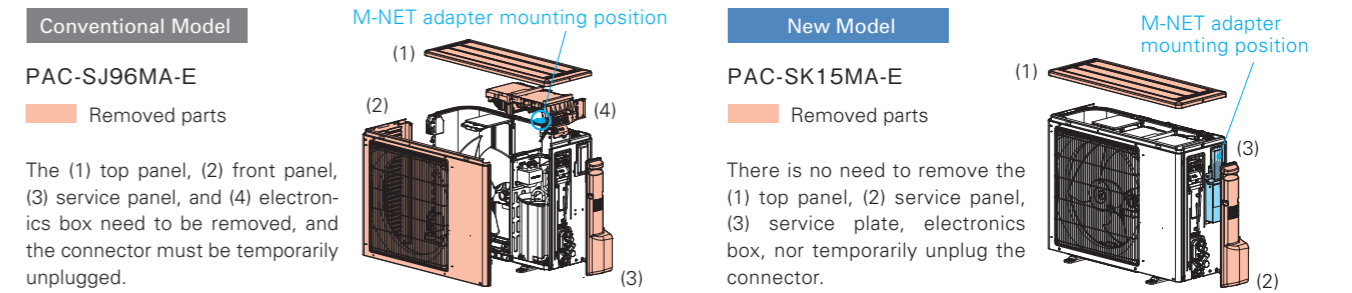

## Improved chargeless piping length ZM100/125/140

PUZ-ZM100/125/140V(Y)KA used to have a chargeless pipe length of 30 m. However, starting with the V(Y)KA2 model, this has been extended to 40 m. This allows it to be used for a wider range of applications without the need for additional charging of refrigerant.

Model	Maximum piping length	Chargeless piping length
PUZ-ZM 100V (Y)KA	100m	30m
PUZ-ZM 125V (Y)KA	100m	30m
PUZ-ZM 140V (Y)KA	100m	30m
PUZ-ZM 100V (Y)KA2	100m	40m
PUZ-ZM 125V (Y)KA2	100m	40m
PUZ-ZM 140V (Y)KA2	100m	40m

## Utilizing IoT for Improved Convenience\*

\*Availability of IoT functions are depending on MELCloud version.


By connecting to a MAC-587IF-E Wi-Fi interface, it is possible to collect data and perform air conditioning control via MELCloud. In addition to basic functions such as turning the power on/off and setting the temperature, it is also possible to acquire data used for maintenance and inspection such as model names, serial numbers, and operation data.

### [Basic Operation Functions]


- Operation on/off
- Temperature setting
- Operation mode
- Airflow speed
- Airflow direction etc...

### [Data Collection and Display]


- Model name display
- Serial number display
- Collection of operation data
- Energy consumption display etc...

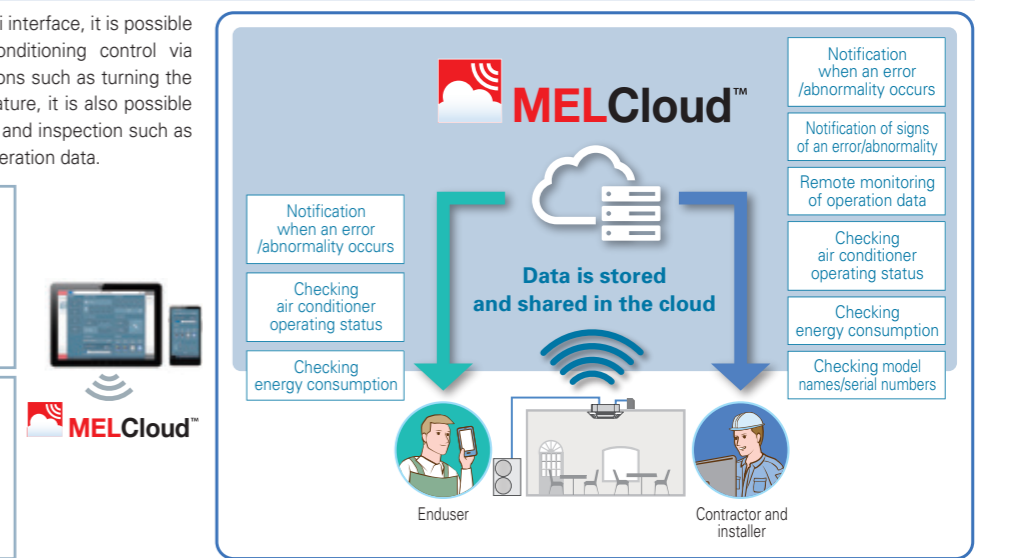

### MELCloud System Configuration

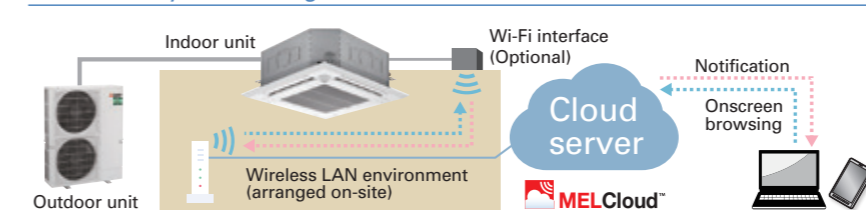

### Wi-Fi Adapter (Optional) Installation

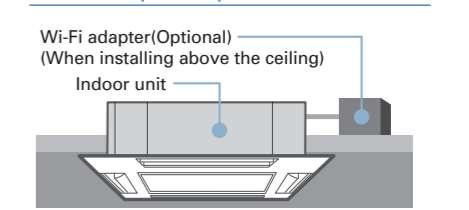

### On-Site Installation and Configuration

- 1 Wireless LAN adapter installation  
Connect the wireless LAN adapter to the indoor unit PCB and install it above the ceiling.
- 2 Wireless LAN adapter and router connection settings
- 3 Wireless LAN adapter and server connection settings



## Collection of operation data

All the operation data required for maintenance and inspection can be collected in a simple step. This data can then be easily checked via MELcloud. This makes it easy to check the operating status data even in cases when it is difficult to do a visual inspection. This allows you to quickly identify any system malfunctions. This function also helps to improve the quality of installation work and shortening the time required for maintenance and inspection.

### Operation data that can be collected (example)

- Compressor frequency ●Compressor operating current ●Outdoor discharge temperature
- Outdoor heat exchanger temperature ●Outdoor air temperature ●Compressor shell temperature
- Sub cool ●Discharge superheat ●Indoor inlet temperature ●Indoor heat exchanger temperature
- Total compressor operating time●Compressor operation count ●Indoor filter operating time

This operation data is strange...



\*1 The total compressor operating time is displayed in units of 10 hours. The compressor operation count is displayed in units of 100.  
\*2 Indicates the elapsed time since a filter sign reset was performed.

## Demand control

It is possible to control air-conditioners to appropriately operate according to the energy supply-demand adjustment by electric power companies and each electricity rate plan of end users.


e.g. <Peak cut control> It is possible to utilize an external demand signal to reduce power consumption during peak hours. By satisfying the need for reducing peak power consumption or shifting consumption to a non-peak period, we have increased the range of options for our customers.

## Notification of potential abnormality

The comprehensive analysis of operating data allows the early detection of abnormalities in small functional parts by alerting the operator of any signs of abnormal behaviour. The recognition in advance of abnormalities in each unit further improves the ease of servicing and maintenance. Since this allows a countermeasure to be implemented before the abnormality requires the unit to be completely shut down, it is an effective method for maintaining the unit in its optimum condition.

### [Abnormalities That Have Their Signs Monitored]

- Filter blockage ●Drain blockage ●Refrigerant leakage
- Heat exchanger blockage etc...

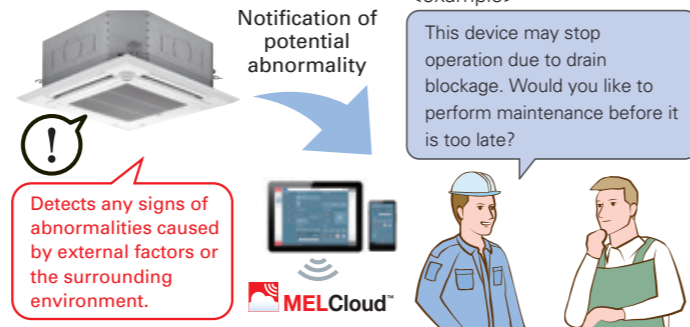

Detects any signs of abnormalities caused by external factors or the surrounding environment.

MELCloud


# Standard Inverter SERIES

Our Standard Series become light and compact with greater energy-saving performance.



## Improved energy efficiency


Introduction of new R32 refrigerant realises improved cooling efficiency. Rating of more than 6.6 achieved for all capacity range.

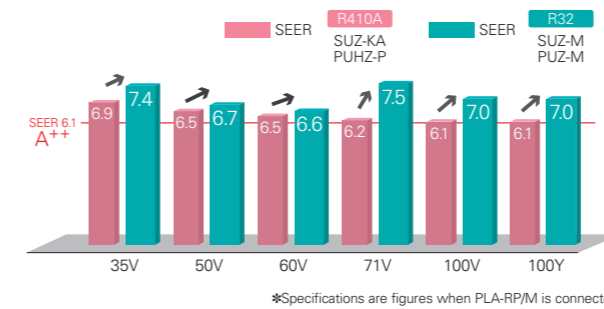

## Longer piping (100/125/140/200/250)


Longer piping length realised for 100, 125, 140, 200 and 250 classes, widely increasing installation flexibility.

	Max. Piping Length	
	R410A SUZ-KA PUHZ-P	R32 SUZ-M PUZ-M
25/35	20m	20m
50/60/71	30m	30m
100	50m	55m
125/140	50m	65m
200/250	70m	70m

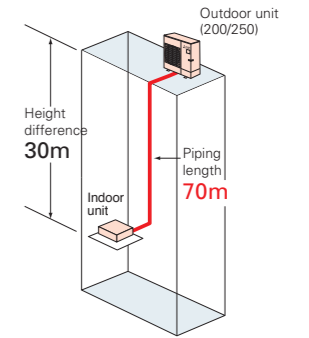


## Light weight and compact size

Compact design fits into narrow outdoor unit space of condominiums and offices. Light weight design facilitates easy installation.

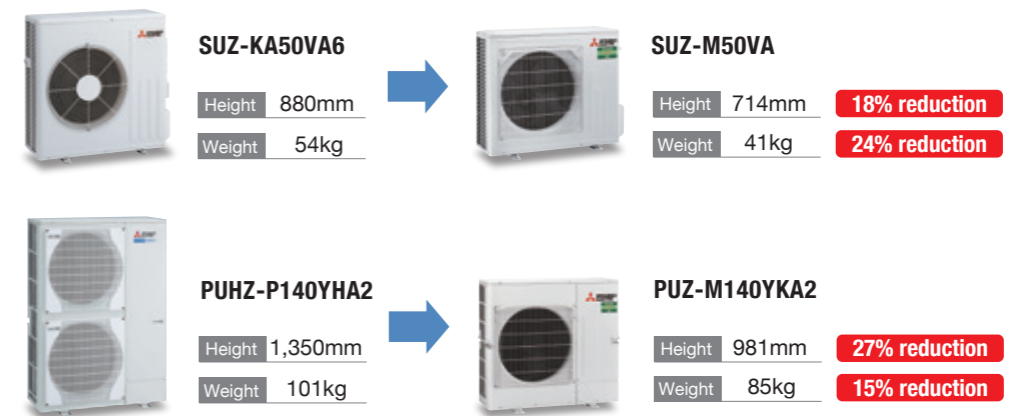


### Unobstructive, compact, and easy to hide from view

Conventional outdoor units may spoil the view. Due to its compact size, the new model can be installed in locations that previous model is not suitable.

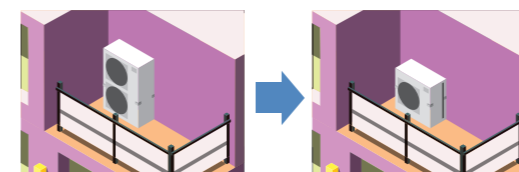

### Easy transportation and installation

The reduced weight and height allow for better transportation performance. Carrying and installing become easier.

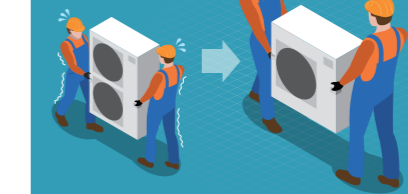

Transport efficiency improves thanks to its low height. The unit can even be transported by minivan.


## 2+1 Back-up rotation\*

The use of a three-refrigerant air conditioning system enables you to utilize the back-up, rotation, and cut-in functions. This allows you to implement effective risk management for added peace of mind.

\*Availability of this function is depending on outdoor unit, indoor unit and remote controller.

### Back-up Function

In the unlikely event that one of the units stops operation due to an abnormality, the standby unit immediately starts back-up operation. Being fully prepared for a failure guarantees that and operation is always available and gives you the confidence that your system will be reliable in any situation.

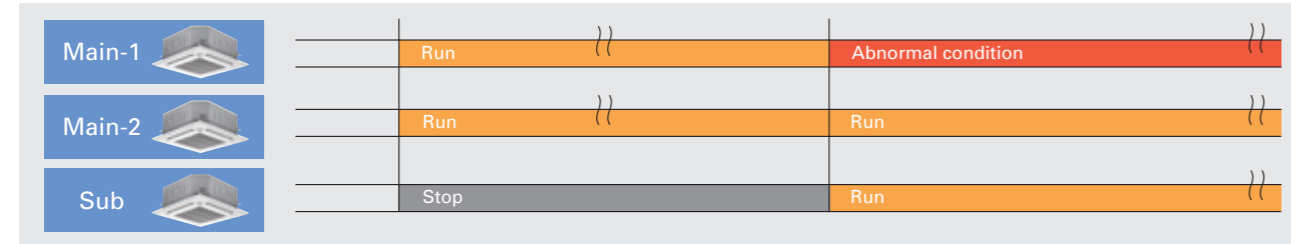


### Rotation Function

A single remote controller is used to operate three-refrigerant air conditioning system in a rotation pattern. Reducing the burden on the equipment allows you to maintain a longer time between maintenance and increases product life.



### Cut-in Function


If the actual room temperature greatly differs from the set temperature and two-refrigerant air conditioning system is insufficient, the standby unit starts operation to provide support.

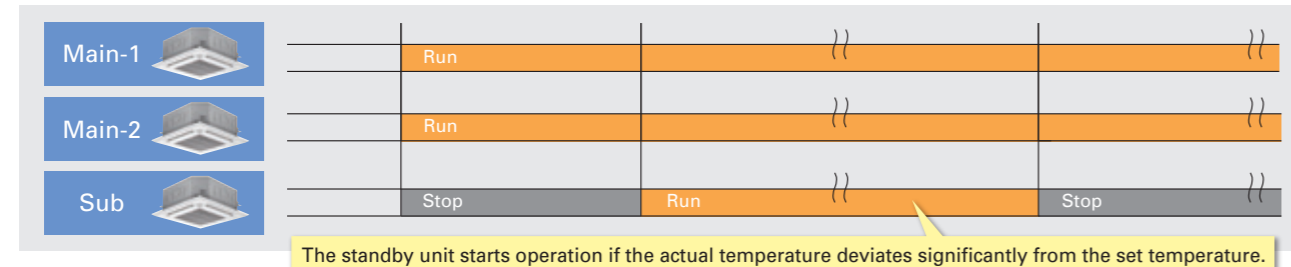

## Extended cooling set temperature range\*

In environments such as gyms where people do strenuous exercise, even if the room is cooled to an appropriate temperature, people may feel that it is hot, and they need a cooler air. To satisfy such demands, we have extended the lower limit of the cooling set temperature range from 19–30°C. to 14–30°C.

\*Insulation kit (PAC-SK36HK-E) is required when indoor unit is PLA series.  
\*Availability of this function is depending on outdoor unit, indoor unit and remote controller.

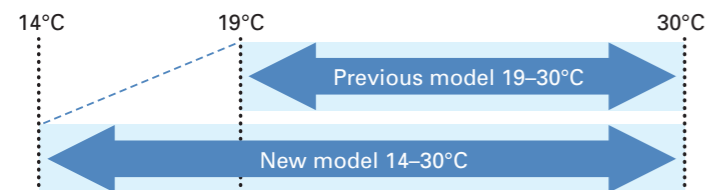

## Display of model names and serial numbers\*

The model names and serial numbers of the indoor/outdoor units that are connected to the MA smart remote controller can be automatically acquired and displayed through one simple operation. This eliminates the need to directly check each unit and helps with inquiries in the case of an abnormality.

\*Availability of this function is depending on outdoor unit, indoor unit and remote controller.

●Model name display (example)

```
Collect model names and S/N
0 OU PUZ-ZM200YKA2
IU1 PLA-ZM50EA2
IU2 PLA-ZM50EA2
IU3 PLA-ZM50EA2
IU4 PLA-ZM50EA2
Collect data: ✓
-Address + S/N
```

●Serial number display (example)

```
Collect model names and S/N
0 OU 1ZU0001
IU1 1ZA0001
IU2 1ZA0002
IU3 1ZA0003
IU4 1ZA0004
Collect data: ✓
-Address + Model
```

## Preliminary error history\*

In addition to error history, the history of preliminary abnormalities can be displayed. The feature enables the unit status check during inspection and maintenance.

\*Availability of this function is depending on outdoor unit, indoor unit and remote controller.

●Error history (Sample)

Error	Unit#	dd/mm/yy
E0	0-1	21/10/20 PM12:34
E0	0-1	20/12/20 AM 1:23
E0	0-1	20/11/20 PM10:55
E0	0-1	20/10/20 PM12:01

●Preliminary error history (Sample)

Error	Unit#	dd/mm/yy
E0	0-1	21/10/20 PM12:34
E0	0-1	20/12/20 AM 1:23
E0	0-1	20/11/20 PM10:55
E0	0-1	20/10/20 PM12:01

## Display of power consumption\*

It is possible to measure, acquire, and display the amount of energy used by each air conditioning system.

\*Availability of this function is depending on outdoor unit, indoor unit and remote controller.

< Data Collection Period >

Time data: Every 30 minutes over the past month

Monthly/daily data: Monthly over the past 14 months

Energy consumption values are calculated from estimated power consumption values according to the operating conditions. They may vary from the actual power consumption values. Please note that the power consumption of optional parts is not included except in the case of optional parts that have their power supplied directly by the outdoor unit.

### ●Every 30 minutes (example)

Time	Energy
0:30	123.4kWh
1:00	123.4kWh
1:30	123.4kWh
2:00	123.4kWh
2:30	123.4kWh
3:00	123.4kWh
3:30	123.4kWh
4:00	123.4kWh

### ●Daily (example)

Date	Energy
2019-1-31	123456.7kWh
2019-1-30	1234.5kWh
2019-1-29	1234.5kWh
2019-1-28	1234.5kWh

### ●Monthly (example)

Year	Month	Energy
2019	1	123456.7kWh
2018	12	123456.7kWh
2018	11	123456.7kWh
2018	10	123456.7kWh
2018	9	123456.7kWh


## Improved defrosting performance\*

\*Availability of this function is depending on outdoor unit, indoor unit and remote controller.


### Avoiding Simultaneous Defrosting

When each of multiple units is in operation for heating in the same space, these may start defrosting at the same time, resulting in a drop in the room temperature. Therefore, we have developed a new function that controls up to four-refrigerant air conditioning system to avoid simultaneous defrosting. By ensuring that defrosting is only performed by one unit at a time, it is possible to minimize any decrease in room temperature.

### Example System Configuration Four sets controlled by a single remote controller

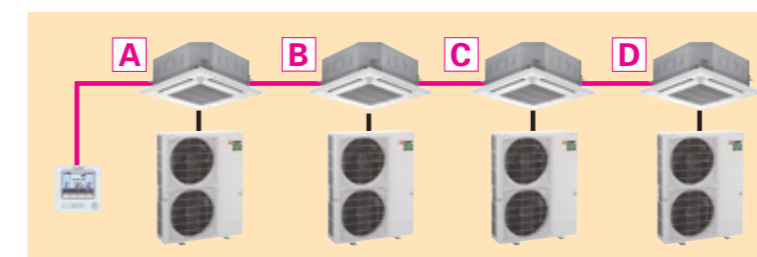

### When All Sets Are Controlled Together

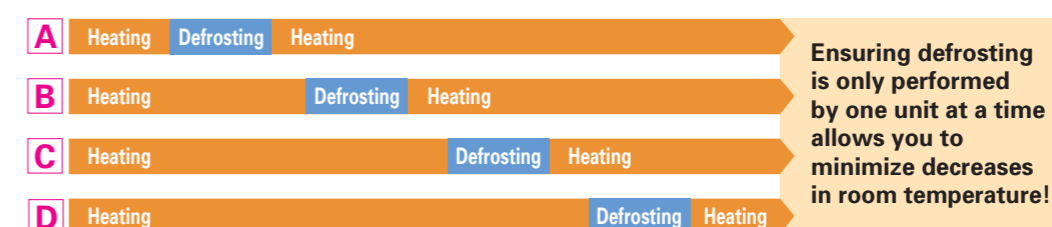

Ensuring defrosting is only performed by one unit at a time allows you to minimize decreases in room temperature!

## Utilizing IoT for Improved Convenience\*

\*Availability of IoT functions are depending on MELCloud version.


By connecting to a MAC-5871F-E Wi-Fi interface, it is possible to collect data and perform air conditioning control via MELCloud. In addition to basic functions such as turning the power on/off and setting the temperature, it is also possible to acquire data used for maintenance and inspection such as model names, serial numbers, and operation data.

### [Basic Operation Functions]


- Operation on/off ● Temperature setting
- Operation mode ● Airflow speed
- Airflow direction etc...

### [Data Collection and Display]


- Model name display ● Serial number display
- Collection of operation data
- Energy consumption display etc...

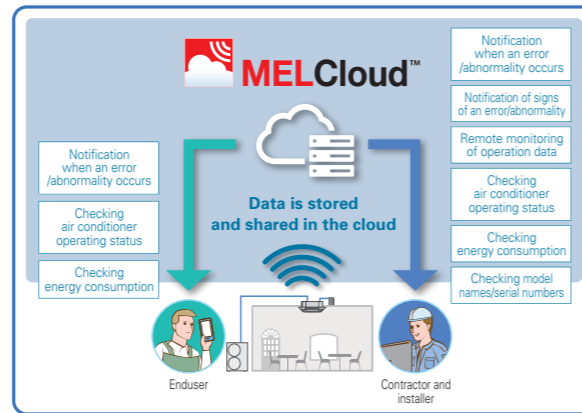

## MELCloud System Configuration

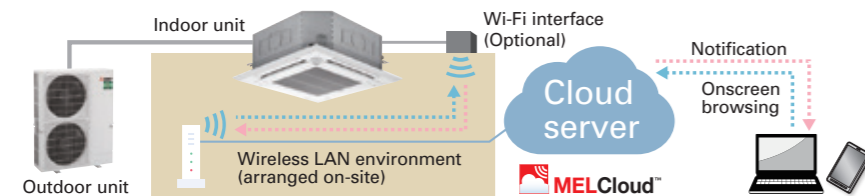

## Wi-Fi Adapter (Optional) Installation

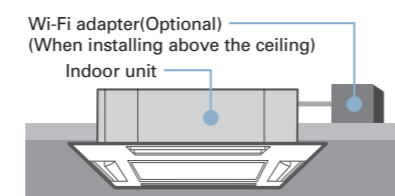

## On-Site Installation and Configuration

### ① Wireless LAN adapter installation

Connect the wireless LAN adapter to the indoor unit PCB and install it above the ceiling.

### ② Wireless LAN adapter and router connection settings

### ③ Wireless LAN adapter and server connection settings

## Collection of operation data

All the operation data required for maintenance and inspection can be collected in a simple step. This data can then be easily checked via MELcloud. This makes it easy to check the operating status data even in cases when it is difficult to do a visual inspection. This allows you to quickly identify any system malfunctions. This function also helps to improve the quality of installation work and shortening the time required for maintenance and inspection.

### Operation data that can be collected (example)

- Compressor frequency ● Compressor operating current ● Outdoor discharge temperature
- Outdoor heat exchanger temperature ● Outdoor air temperature ● Compressor shell temperature
- Sub cool ● Discharge superheat ● Indoor inlet temperature ● Indoor heat exchanger temperature
- Total compressor operating time ● Compressor operation count ● Indoor filter operating time



\*1 The total compressor operating time is displayed in units of 10 hours. The compressor operation count is displayed in units of 100.  
\*2 Indicates the elapsed time since a filter sign reset was performed.


## Demand control

It is possible to control air-conditioners to appropriately operate according to the energy supply-demand adjustment by electric power companies and each electricity rate plan of end users.

e.g. <Peak cut control> It is possible to utilize an external demand signal to reduce power consumption during peak hours. By satisfying the need for reducing peak power consumption or shifting consumption to a non-peak period, we have increased the range of options for our customers.

## Notification of potential abnormality

The comprehensive analysis of operating data allows the early detection of abnormalities in small functional parts by alerting the operator of any signs of abnormal behaviour. The recognition in advance of abnormalities in each unit further improves the ease of servicing and maintenance. Since this allows a countermeasure to be implemented before the abnormality requires the unit to be completely shut down, it is an effective method for maintaining the unit in its optimum condition.

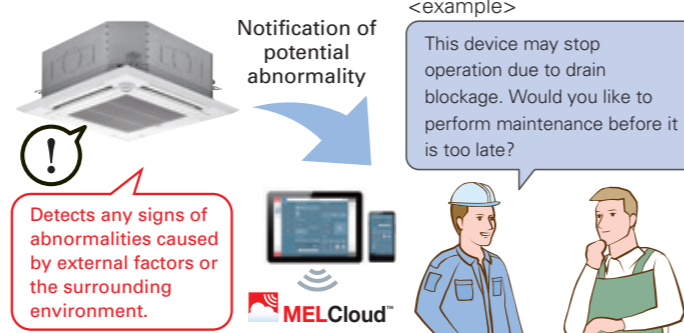

### [Abnormalities That Have Their Signs Monitored]

- Filter blockage ● Drain blockage ● Refrigerant leakage
- Heat exchanger blockage etc...

R32  
R410A  
PLA-ZM35/50/60/71/100/125/140EA2



R32  
R410A  
PLA-M35/50/60/71/100/125/140EA2



# PLA SERIES

A complete line-up including deluxe units that offer added energy savings. The incorporation of "3D total flow" and the "3D i-see Sensor" enhances airflow distribution control, achieving an enhanced level of comfort throughout the room. The synergy of higher energy efficiency and more comfortable room environment results in the utmost user satisfaction.



## Deluxe 4-way Cassette Line-up

For users seeking even further energy savings, Mitsubishi Electric now offers deluxe units (PLA-ZM) to complete the line-up of models in this series, from 35-140. Compared to the standard models (PLA-M), deluxe models provide additional energy savings, contributing to a significant reduction in electricity costs.

### Line-up


Series	Model	35	50	60	71	100	125	140
R32 R410A	Deluxe 4-way Cassette (PLA-ZM)	●	●	●	●	●	●	●
R32 R410A	Standard 4-way Cassette (PLA-M)	●	●	●	●	●	●	●

### Indoor/Outdoor Unit Combinations

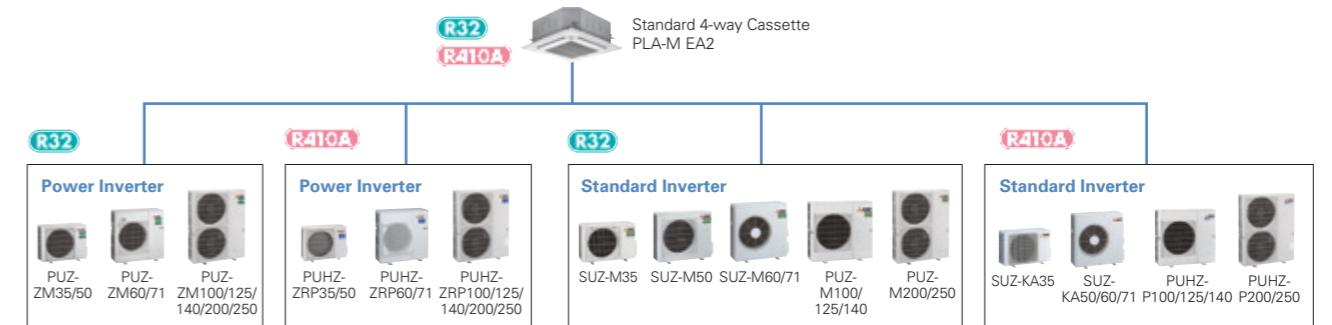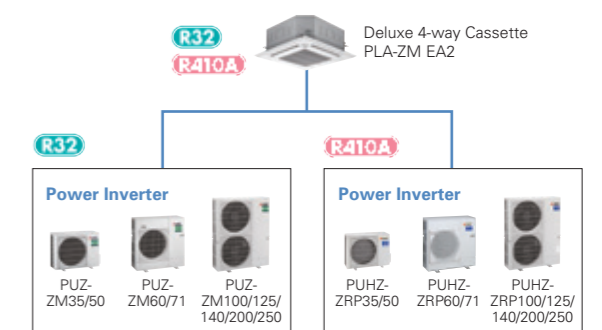

## Industry-leading energy efficiency

Introduction of new R32 refrigerant realises improved cooling efficiency. Rating of more than 7.0 achieved for all capacity range. Introduction of new R32 refrigerant reduces energy consumption and realises energy savings.

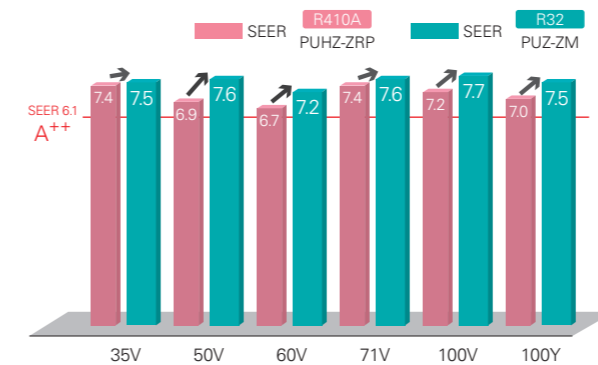


## Horizontal Airflow

The new airflow control removes that uncomfortable drafty feeling with the introduction of a horizontal airflow that spreads across the ceiling. The ideal airflow for offices and restaurants.



[Horizontal airflow]  
Model name: PLA-ZM140EA2  
Ceiling height: 3.2m  
Mode: Cooling

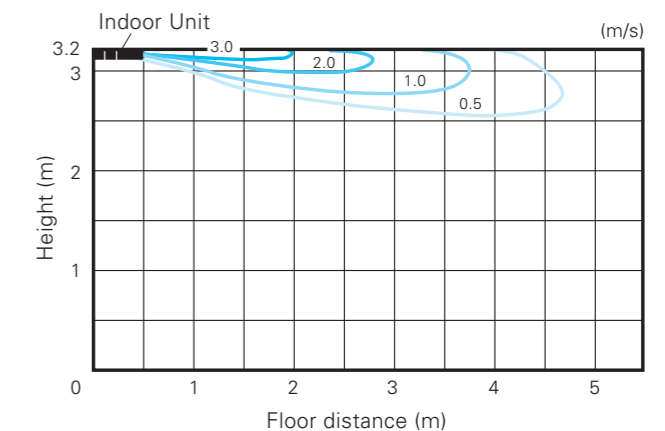



## Automatic Grille Lowering Function (PLP-6EAJ, PLP-6EAJE)\*

An automatic grille lowering function is available for easy filter maintenance. Special wired and wireless remote controllers can be used to lower the intake grille for maintenance.

\*Auto elevation panel(PLP-6EAJ,PLP-6EAJE) cannot be used with Plasma Quad Connect(PAC-SK51FT-E) and Insulation kit (PAC-SK36HK-E).




Grille Elevation Remote Controller (comes with the automatic elevation panel)



Wired Remote Controller



Wireless Remote Controller

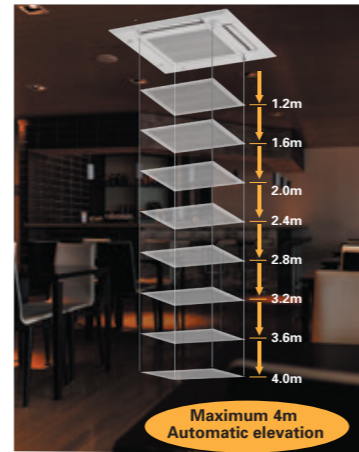

Maximum 4m Automatic elevation

## Easy Installation

### Electrical box wiring

After reviewing the power supply terminal position in the electrical box, the structure was redesigned to improve connectivity. This has made previously complex wiring work easier.

■ Previous model (B Series)




■ New model (E Series)



### Increased space for plumbing work

The top and bottom positions of the liquid and gas pipes have been reversed to allow the gas pipe work, which requires more effort, to be completed first. Further, through structural innovations related to the space around the pipes, the area where the spanner can be moved has been increased, thus improving liquid pipe work and enabling it to be completed smoothly.

■ Previous model (B Series)

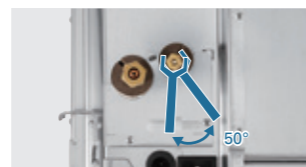

■ New model (E Series)



### Temporary hanging hook

The structure of the panel has been revised and is now equipped with a temporary hanging hook. This has improved work efficiency during panel installation.



### No need to remove screws

Installation is possible without removing the screws for the corner panel and the control box, simply loosen them. This lowers the risk of losing screws.

■ Corner panel



■ Control box cover



### Lightweight decorative panel

After reviewing the structure and materials, weight has been reduced approximately 20% compared to the previous model, reducing the burden of installation.



## 3D i-see Sensor for S & P SERIES

### Detects number of people


3D i-see Sensor detects the number of people in the room and sets the air-conditioning power accordingly. This makes automatic power-saving operation possible in places where the number of people entering and exiting is large. Additionally, when the area is continuously unoccupied, the system switches to a more enhanced power-saving mode. Depending on the setting, it will save additional capacity or stop operation altogether.

### Detects people's position


Once the position of a person is detected, the duct angle of the vane is automatically adjusted in that direction. Each vane can be independently set to "block wind" or "not block wind" according to taste.



Detects number of people



Detects people's position

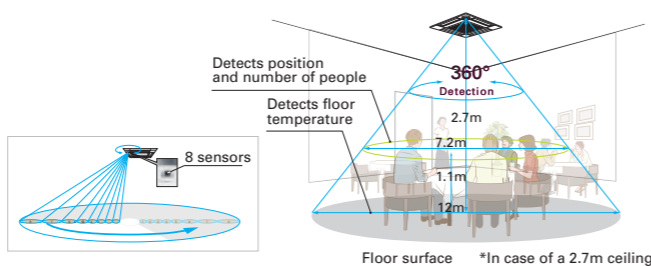


Floor surface \*In case of a 2.7m ceiling

## Detects number of people (3D i-see Sensor)

### Room occupancy energy-saving mode

The 3D i-see Sensor detects the number of people in the room. It then calculates the occupancy rate based on the maximum number of people in the room up to that point in time in order to save air-conditioning power. When the occupancy rate is approximately 30%, air-conditioning power equivalent to 1°C during both cooling and heating operation is saved. The temperature is controlled according to the number of people.


Room occupancy energy save mode

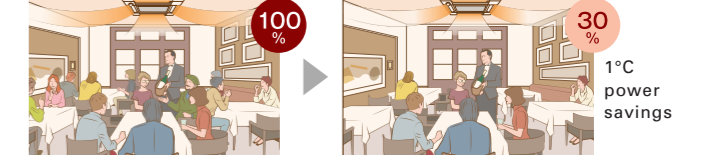

### No occupancy energy-saving mode

When 3D i-see Sensor detects that no one is in the room, the system is switched to a pre-set power-saving mode. If the room remains unoccupied for more than 60min, air-conditioning power equivalent to 2°C during both cooling and heating operation is saved. This contributes to preventing waste in terms of heating and cooling.


No occupancy energy save mode

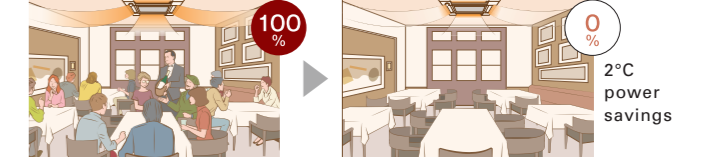

### No occupancy Auto-OFF mode\*

When the room remains unoccupied for a pre-set period of time, the air conditioner turns off automatically, thereby providing even greater power savings. The time until operation is stopped can be set in intervals of 10min, ranging from 60 to 180 min.

No occupancy Auto-Off mode

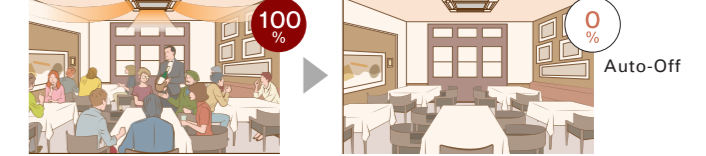


\*PAR-41MAA is required for each setting

## Detects people's position (3D i-see Sensor)

### Direct/Indirect settings\*

Some people do not like the feel of wind, some want to be warm from head to toe. People's likes and dislikes vary. With the 3D i-see Sensor, it is possible to choose to block or not block to the wind for each vane.

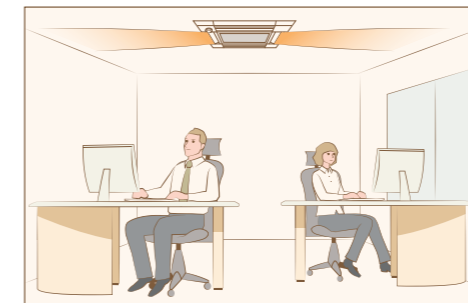

\*PAR-41MAA or PAR-SL101A-E is required for each setting.


### Seasonal airflow\*

#### <When cooling>

Saves energy while keeping a comfortable effective temperature by automatically switching between ventilation and cooling. When a pre-set temperature is reached, the air conditioning unit switches to swing fan operation to maintain the effective temperature. This clever function contributes to keeping a comfortable coolness.

#### <When heating>

The air conditioning unit automatically switches between circulator and heating. Wasted heat that accumulates near the ceiling is reused via circulation. When a pre-set temperature is reached the air conditioner switches from heating to circulator and blows air in the horizontal direction. It pushes down the warm air that has gathered near the ceiling to people's height, thereby providing smart heating.

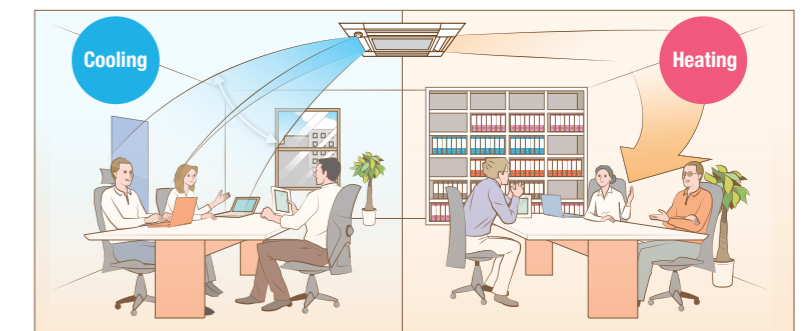


\*PAR-41MAA is required for each setting.

## 3D Total Flow\*


3D Total Flow is an innovative function. Our original 3D i-see sensor detects the temperature of the floor, and then the newly installed 3D Total Flow unit automatically controls the airflow in the left/right directions in a smart manner.

\*3D Total Flow unit(PLP-U160ELR-E) cannot be used with Plasma Quad Connect(PAC-SK51FT-E), Insulation kit(PAC-SK36HK-E), Shutter Plate(PAC-SJ37SP-E), Multi functional casement(PAC-SJ41TM-E) and High-efficiency filter element(PAC-SH59KF-E)

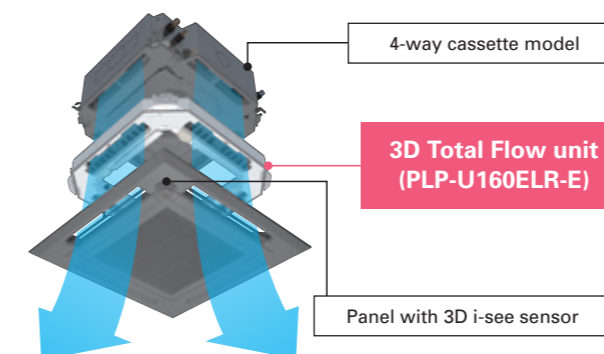


## Horizontal louver (3D Total Flow)

In addition to the ability of conventional models to control airflow in the vertical direction, the adoption of a horizontal louver unit allows each outlet to blow air over a horizontal angle of 90 degrees. The combination of four outlets delivers 360° airflow control around the entire circumference. This now makes it possible to blow air in diagonal directions which eliminates temperature irregularities.

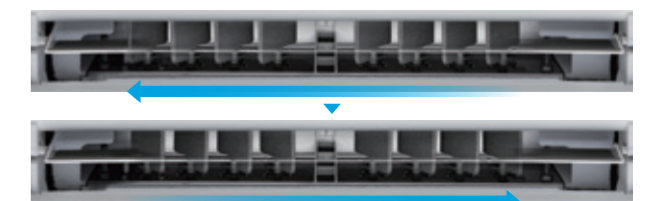

louvers can provide horizontal airflow control.

## Fine-tuned sensing & airflow direction control (3D Total Flow)





### Swinging

Since airflow can be controlled in the horizontal and vertical directions, you can efficiently make the entire room comfortable.

### Horizontal, vertical, and diagonal airflow delivered to every corner

The combination of the vertical vanes with the horizontal louver unit makes it possible to direct airflow in any direction. This quickly makes the entire room comfortable, even when diagonal airflow is necessary.


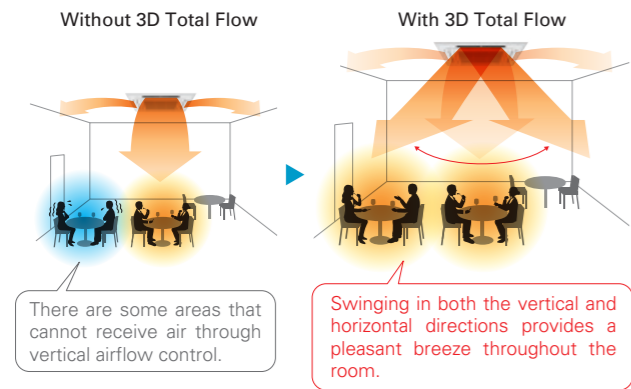


### Targeting

The system can detect spaces with uneven temperatures and target them by sending air even if they are in a diagonal direction.

### Detects and targets areas with uneven temperatures

3D i-see sensor detects areas with uneven temperatures, even if they are caused by the installation orientation of the air conditioner or the influence of strong sunlight. Efficient air conditioning is possible thanks to the ability to send focused airflow to such areas, even those in a diagonal position.


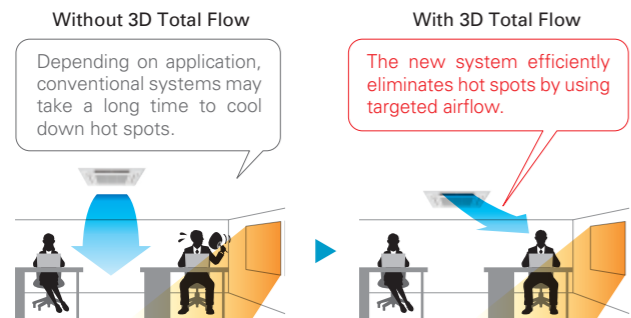


### Indirect mode

When set to "Indirect" mode, the system detects the position of a person and maintains comfort while diverting airflow away from them.

### Prevents direct airflow and keeps you comfortable

This function prevents people from being directly exposed to airflow while still ensuring comfort. The "Indirect" mode of 3D Total Flow keeps the downward airflow while avoiding direct blow to people, delivering a pleasant warmth.

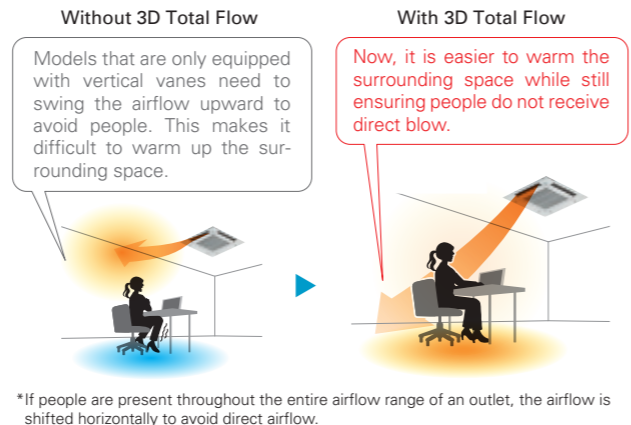


### Direct mode

When set to "Direct" mode, the system detects the position and diverts airflow towards wherever they are located.

### Delivers airflow even in diagonal directions


You can freely turn on "Direct" mode depending on personal preference. This allows for air conditioning in diagonal directions which was difficult for models that could only swing the airflow up and down. This feature is perfect for when you come back home on a hot day.

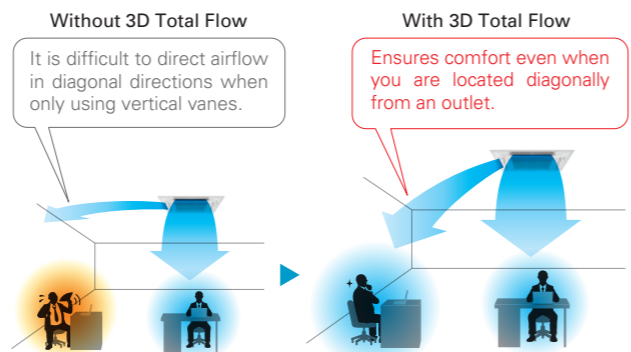

## Connectable to Plasma Quad Connect\*

The optional Plasma Quad Connect PAC-SK51FT-E can be installed on the indoor units.

\*Plasma Quad Connect(PAC-SK51FT-E) cannot be used with PLP-U160ELR-E(3D Total Flow unit), Insulation kit (PAC-SK36HK-E), Auto elevation panel(PLP-6EAJ, PLP-6EAJE), Multi functional casement(PAC-SJ41TM-E) and High-efficiency filter element(PAC-SH59KF-E).

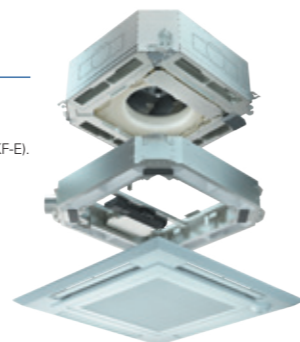

## SERIES SELECTION

### Power Inverter Series

#### Indoor Unit

R32  
R410A



Panel PLA-ZM35/50/60/71/100/125/140EA2

Panel	With Signal Receiver	With 3D i-see Sensor	With Wireless Remote Controller	With Auto Elevation
PLP-6EA				
PLP-6EAL	✓			
PLP-6EAE		✓		
PLP-6EALM2	✓	✓		
PLP-6EALM2	✓	✓	✓	
PLP-6EALM2	✓	✓	✓	✓
PLP-6EALM2	✓	✓	✓	✓

\*Auto elevation panel(PLP-6EAJ, PLP-6EAJE) cannot be used with Plasma Quad Connect(PAC-SK51FT-E) and Insulation kit (PAC-SK36HK-E).

#### 3D Total Flow Unit

PLP-U160ELR-E (optional)

#### Remote Controller



#### Outdoor Unit

R32

For Single



PUZ-ZM35/50 PUZ-ZM60/71 PUZ-ZM100/125/140

R32

For Multi (Twin/Triple/Quadruple)



PUZ-ZM71 PUZ-ZM100/125/140/200/250

### PLA-ZM EA2 Indoor Unit Combinations Indoor unit combinations shown below are possible.

Indoor Unit Combination	Outdoor Unit Capacity																			
	For Single								For Twin				For Triple		For Quadruple					
	35	50	60	71	100	125	140	200	250	71	100	125	140	200	250	140	200	250	200	250
Power Inverter (PUZ-ZM)	35x1	50x1	60x1	71x1	100x1	125x1	140x1	-	-	35x2	50x2	60x2	71x2	100x2	125x2	50x3	60x3	71x3	50x4	60x4
Distribution Pipe	-	-	-	-	-	-	-	-	-	MSDD-50TR2-E				MSDD-50WR2-E		MSDT-111R3-E		MSDF-111R2-E		

## SERIES SELECTION

### Standard Inverter Series

#### Indoor Unit

R32  
R410A



Panel PLA-M35/50/60/71/100/125/140EA2


Panel	With Signal Receiver	With 3D i-see Sensor	With Wireless Remote Controller	With Auto Elevation
PLP-6EA				
PLP-6EAL	✓			
PLP-6EAE		✓		
PLP-6EALM2	✓	✓		
PLP-6EALM2	✓	✓	✓	
PLP-6EALM2	✓	✓	✓	✓

\*Auto elevation panel(PLP-6EAJ, PLP-6EAJE) cannot be used with Plasma Quad Connect(PAC-SK51FT-E) and Insulation kit (PAC-SK36HK-E).

#### 3D Total Flow Unit

PLP-U160ELR-E\* (optional)  
\*SUZ combination is not available.

#### Remote Controller

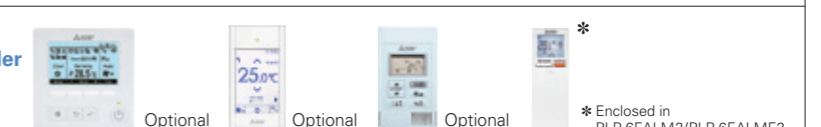

#### Outdoor Unit

R32

For Single



SUZ-M35 SUZ-M50 SUZ-M60/71 PUZ-M100/125/140

R32

For Multi (Twin/Triple/Quadruple)



PUZ-M100/125/140 PUZ-M200/250

### PLA-M EA2 Indoor Unit Combinations Indoor unit combinations shown below are possible.

Indoor Unit Combination	Outdoor Unit Capacity																		
	For Single								For Twin				For Triple		For Quadruple				
	35	50	60	71	100	125	140	200	250	71	100	125	140	200	250	140	200	250	200
Standard Inverter (SUZ & PUZ-M)	35x1	50x1	60x1	71x1	100x1	125x1	140x1	-	-	50x2	60x2	71x2	100x2	125x2	50x3	60x3	71x3	50x4	60x4
Distribution Pipe	-	-	-	-	-	-	-	-	-	MSDD-50TR2-E				MSDD-50WR2-E		MSDT-111R3-E		MSDF-111R2-E	



**PLA-ZM SERIES**  
POWER INVERTER



Type	Inverter Heat Pump												
Indoor Unit	PLA-M35EA2	PLA-M50EA2	PLA-M60EA2	PLA-M71EA2	PLA-M100EA2	PLA-M125EA2	PLA-M150EA2	PLA-M125EA2	PLA-M140EA2	PLA-M140EA2	PLA-M140EA2	PLA-M140EA2	
Outdoor Unit	SUZ-M35VA	SUZ-M50VA	SUZ-M60VA	SUZ-M71VA	PUZ-M100KA2	PUZ-M125KA2	PUZ-M150KA2	PUZ-M125KA2	PUZ-M140KA2	PUZ-M140KA2	PUZ-M140KA2	PUZ-M140KA2	
Refrigerant <sup>(*)</sup>	R32												
Power Supply	Outdoor power supply VA-VKA:230/Single/50, YKA:400/Three/50												
Cooling	Outdoor(V/Phase/Hz)												
	Capacity	Rated	kW										
	Min-Max	Rated	kW										
	Total Input	Rated	kW										
	EER	Rated	-										
	Design load		kW										
	Annual electricity consumption <sup>(2)</sup>		kWh/a										
	SEER <sup>(4)</sup>		-										
	Energy efficiency class												
	A++												
Heating	Energy efficiency class												
	A++												
	Capacity	Rated	kW										
	Min-Max	Rated	kW										
	Total Input	Rated	kW										
	COP	Rated	-										
	Design load		kW										
	Declared Capacity	at reference design temperature	kW										
	at bivalent temperature	kW											
	at operation limit temperature	kW											
Back up heating capacity		kW											
Annual electricity consumption <sup>(2)</sup>		kWh/a											
SEER <sup>(4)</sup>		-											
Energy efficiency class													
A++													
Operating Current(Max)		A											
Indoor Unit	Input [cooling / Heating]	Rated	kW										
	Operating Current(Max)		A										
	Dimensions	H*W*D	mm										
	Weight		kg										
	Air Volume (Lo-Mi2-Mi1-Hi)		m³/min										
	Sound Level (Lo-Mi2-Mi1-Hi) (SPL)		dB(A)										
	Sound Level (PWL)		dB(A)										
	Operating Current(Max)		A										
	Breaker Size		A										
	Outdoor Unit	Dimensions	H*W*D	mm									
Weight			kg										
Air Volume		Cooling	m³/min										
Heating		m³/min											
Sound Level (SPL)		Cooling	dB(A)										
Heating		dB(A)											
Sound Level (PWL)		Cooling	dB(A)										
Operating Current(Max)			A										
Breaker Size			A										
Ext.Piping		Diameter <sup>(5)</sup>	Liquid/Gas	mm									
	Max.Length	Out-In	m										
	Max.Height	Out-In	m										
	Guaranteed Operating Range (Outdoor)	Cooling <sup>(3)</sup>	°C										
	Heating	°C											

\*1 Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP, if leaked to the atmosphere. This appliance contains a refrigerant fluid with a GWP equal to 550. This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be 550 times higher than 1 kg of CO<sub>2</sub>, over a period of 100 years. Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional. The GWP of R32 is 675 in the IPCC 4th Assessment Report.  
 \*2 Energy consumption based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.  
 \*3 Optional air protection guide is required where ambient temperature is lower than -5°C.  
 \*4 SEER and SCOP are based on 2009/125/EC:Energy-related Products Directive and Regulation(EU) No206/2012. \*5 Joint pipe is required depending on installed refrigerant pipes, outdoor units and indoor units.

**PLA-M SERIES**  
STANDARD INVERTER



Type	Inverter Heat Pump												
Indoor Unit	PLA-M35EA2	PLA-M50EA2	PLA-M60EA2	PLA-M71EA2	PLA-M100EA2	PLA-M125EA2	PLA-M150EA2	PLA-M125EA2	PLA-M140EA2	PLA-M140EA2	PLA-M140EA2	PLA-M140EA2	
Outdoor Unit	SUZ-M35VA	SUZ-M50VA	SUZ-M60VA	SUZ-M71VA	PUZ-M100KA2	PUZ-M125KA2	PUZ-M150KA2	PUZ-M125KA2	PUZ-M140KA2	PUZ-M140KA2	PUZ-M140KA2	PUZ-M140KA2	
Refrigerant <sup>(*)</sup>	R32												
Power Supply	Outdoor power supply VA-VKA:230/Single/50, YKA:400/Three/50												
Cooling	Outdoor(V/Phase/Hz)												
	Capacity	Rated	kW										
	Min-Max	Rated	kW										
	Total Input	Rated	kW										
	EER	Rated	-										
	Design load		kW										
	Annual electricity consumption <sup>(2)</sup>		kWh/a										
	SEER <sup>(4)</sup>		-										
	Energy efficiency class												
	A++												
Heating	Energy efficiency class												
	A++												
	Capacity	Rated	kW										
	Min-Max	Rated	kW										
	Total Input	Rated	kW										
	COP	Rated	-										
	Design load		kW										
	Declared Capacity	at reference design temperature	kW										
	at bivalent temperature	kW											
	at operation limit temperature	kW											
Back up heating capacity		kW											
Annual electricity consumption <sup>(2)</sup>		kWh/a											
SEER <sup>(4)</sup>		-											
Energy efficiency class													
A++													
Operating Current(Max)		A											
Indoor Unit	Input [cooling / Heating]	Rated	kW										
	Operating Current(Max)		A										
	Dimensions	H*W*D	mm										
	Weight		kg										
	Air Volume (Lo-Mi2-Mi1-Hi)		m³/min										
	Sound Level (Lo-Mi2-Mi1-Hi) (SPL)		dB(A)										
	Sound Level (PWL)		dB(A)										
	Operating Current(Max)		A										
	Breaker Size		A										
	Outdoor Unit	Dimensions	H*W*D	mm									
Weight			kg										
Air Volume		Cooling	m³/min										
Heating		m³/min											
Sound Level (SPL)		Cooling	dB(A)										
Heating		dB(A)											
Sound Level (PWL)		Cooling	dB(A)										
Operating Current(Max)			A										
Breaker Size			A										
Ext.Piping		Diameter <sup>(5)</sup>	Liquid/Gas	mm									
	Max.Length	Out-In	m										
	Max.Height	Out-In	m										
	Guaranteed Operating Range (Outdoor)	Cooling <sup>(3)</sup>	°C										
	Heating	°C											

\*1 Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP, if leaked to the atmosphere. This appliance contains a refrigerant fluid with a GWP equal to 550. This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be 550 times higher than 1 kg of CO<sub>2</sub>, over a period of 100 years. Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional. The GWP of R32 is 675 in the IPCC 4th Assessment Report.  
 \*2 Energy consumption based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.  
 \*3 Optional air protection guide is required where ambient temperature is lower than -5°C.  
 \*4 SEER and SCOP are based on 2009/125/EC:Energy-related Products Directive and Regulation(EU) No206/2012. \*5 Joint pipe is required depending on installed refrigerant pipes, outdoor units and indoor units.

**PLA-M SERIES**  
POWER INVERTER




Type	Inverter Heat Pump												
Indoor Unit	PLA-M35EA2	PLA-M50EA2	PLA-M60EA2	PLA-M71EA2	PLA-M100EA2	PLA-M125EA2	PLA-M150EA2	PLA-M125EA2	PLA-M140EA2	PLA-M140EA2	PLA-M140EA2	PLA-M140EA2	
Outdoor Unit	PUZ-M35KA2	PUZ-M50KA2	PUZ-M60KA2	PUZ-M71KA2	PUZ-M100KA2	PUZ-M125KA2	PUZ-M150KA2	PUZ-M125KA2	PUZ-M140KA2	PUZ-M140KA2	PUZ-M140KA2	PUZ-M140KA2	
Refrigerant <sup>(*)</sup>	R32												
Power Supply	Outdoor power supply VA-VKA:230/Single/50, YKA:400/Three/50												
Cooling	Outdoor(V/Phase/Hz)												
	Capacity	Rated	kW										
	Min-Max	Rated	kW										
	Total Input	Rated	kW										
	EER	Rated	-										
	Design load		kW										
	Annual electricity consumption <sup>(2)</sup>		kWh/a										
	SEER <sup>(4)</sup>		-										
	Energy efficiency class												
	A++												
Heating (Average Season)	Energy efficiency class												
	A++												
	Capacity	Rated	kW										
	Min-Max	Rated	kW										
	Total Input	Rated	kW										
	COP	Rated	-										
	Design load		kW										
	Declared Capacity	at reference design temperature	kW										
	at bivalent temperature	kW											
	at operation limit temperature	kW											
Back up heating capacity		kW											
Annual electricity consumption <sup>(2)</sup>		kWh/a											
SEER <sup>(4)</sup>		-											
Energy efficiency class													
A++													
Operating Current(Max)		A											
Indoor Unit	Input [cooling / Heating]	Rated	kW										
	Operating Current(Max)		A										
	Dimensions	H*W*D	mm										
	Weight		kg										
	Air Volume (Lo-Mi2-Mi1-Hi)		m³/min										
	Sound Level (Lo-Mi2-Mi1-Hi) (SPL)		dB(A)										
	Sound Level (PWL)		dB(A)										
	Operating Current(Max)		A										
	Breaker Size		A										
	Outdoor Unit	Dimensions	H*W*D	mm									
Weight			kg										
Air Volume		Cooling	m³/min										
Heating		m³/min											
Sound Level (SPL)		Cooling	dB(A)										
Heating		dB(A)											
Sound Level (PWL)		Cooling	dB(A)										
Operating Current(Max)			A										
Breaker Size			A										
Ext.Piping		Diameter <sup>(5)</sup>	Liquid/Gas	mm									
	Max.Length	Out-In	m										
	Max.Height	Out-In	m										
	Guaranteed Operating Range (Outdoor)	Cooling <sup>(3)</sup>	°C										
	Heating	°C											

\*1 Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP, if leaked to the atmosphere. This appliance contains a refrigerant fluid with a GWP equal to 550. This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be 550 times higher than 1 kg of CO<sub>2</sub>, over a period of 100 years. Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional. The GWP of R32 is 675 in the IPCC 4th Assessment Report.  
 \*2 Energy consumption based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.  
 \*3 Optional air protection guide is required where ambient temperature is lower than -5°C.  
 \*4 SEER and SCOP are based on 2009/125/EC:Energy-related Products Directive and Regulation(EU) No206/2012. \*5 Joint pipe is required depending on installed refrigerant pipes, outdoor units and indoor units.

## SERIES SELECTION

### Power Inverter Series

#### Indoor Unit




PLA-ZM35/50/60/71/100/125/140EA2

#### Panel

Panel	With Signal Receiver	With 3D i-see Sensor	With Wireless Remote Controller	With Auto Elevation
PLP-6EA				
PLP-6EAL	✓			
PLP-6EAE		✓		
PLP-6EALAE	✓	✓		
PLP-6EAJE	✓			✓
PLP-6EALJE	✓	✓		✓
PLP-6EALM2	✓		✓	
PLP-6EALME2	✓	✓	✓	

#### Outdoor Unit


For Single



PUHZ-ZRP35/50    PUHZ-ZRP60/71    PUHZ-ZRP100/125/140


---

For Multi (Twin/Triple/Quadruple)



PUHZ-ZRP71    PUHZ-ZRP100/125/140/200/250

#### Remote Controller

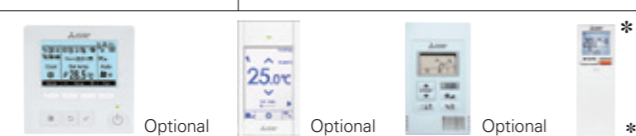

Optional    Optional    Optional    \*

\* Enclosed in PLP-6EALM2/PLP-6EALME2


PLA-ZM EA2 Indoor Unit Combinations Indoor unit combinations shown below are possible.

Indoor Unit Combination	Outdoor Unit Capacity																				
	For Single								For Twin				For Triple		For Quadruple						
	35	50	60	71	100	125	140	200	250	71	100	125	140	200	250	140	200	250	200	250	
Power Inverter (PUHZ-ZRP)	35x1	50x1	60x1	71x1	100x1	125x1	140x1	-	-	35x2	50x2	60x2	71x2	100x2	125x2	50x3	60x3	71x3	50x4	60x4	
Distribution Pipe	-	-	-	-	-	-	-	-	-	MSDD-50TR-E				MSDD-50WR-E		MSDT-111R-E		MSDF-1111R-E		-	-

## SERIES SELECTION

### Standard Inverter Series

#### Indoor Unit




PLA-M35/50/60/71/100/125/140EA2

#### Panel

Panel	With Signal Receiver	With 3D i-see Sensor	With Wireless Remote Controller	With Auto Elevation
PLP-6EA				
PLP-6EAL	✓			
PLP-6EAE		✓		
PLP-6EALAE	✓	✓		
PLP-6EAJE	✓			✓
PLP-6EALJE	✓	✓		✓
PLP-6EALM2	✓		✓	
PLP-6EALME2	✓	✓	✓	

#### Outdoor Unit


For Single



SUZ-KA35    SUZ-KA50/60/71    PUHZ-P100/125/140


---

For Multi (Twin/Triple/Quadruple)



PUHZ-P100/125/140    PUHZ-P200/250

#### Remote Controller

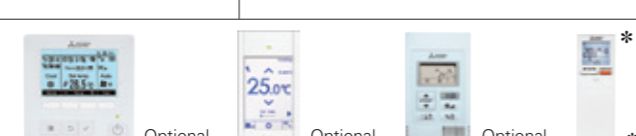

Optional    Optional    Optional    \*

\* Enclosed in PLP-6EALM2/PLP-6EALME2

PLA-M EA2 Indoor Unit Combinations Indoor unit combinations shown below are possible.

Indoor Unit Combination	Outdoor Unit Capacity																				
	For Single								For Twin				For Triple		For Quadruple						
	35	50	60	71	100	125	140	200	250	71	100	125	140	200	250	140	200	250	200	250	
Standard Inverter (SUZ & PUHZ-P)	35x1	50x1	60x1	71x1	100x1	125x1	140x1	-	-	50x2	60x2	71x2	100x2	125x2	50x3	60x3	71x3	50x4	60x4		
Distribution Pipe	-	-	-	-	-	-	-	-	-	MSDD-50TR-E				MSDD-50WR-E		MSDT-111R-E		MSDF-1111R-E		-	-

## PLA-ZM SERIES

### POWER INVERTER

Type	Inverter Heat Pump													
Indoor Unit	PLA-ZM35EA2	PLA-ZM50EA2	PLA-ZM60EA2	PLA-ZM71EA2	PLA-ZM100EA2	PLA-ZM100EA2	PLA-ZM125EA2	PLA-ZM125EA2	PLA-ZM140EA2	PLA-ZM140EA2	PLA-ZM140EA2	PLA-ZM140EA2		
Outdoor Unit	PUHZ-ZRP35KA2	PUHZ-ZRP50KA2	PUHZ-ZRP60KA2	PUHZ-ZRP71KA2	PUHZ-ZRP100KA2	PUHZ-ZRP100KA2	PUHZ-ZRP125KA2	PUHZ-ZRP125KA2	PUHZ-ZRP140KA2	PUHZ-ZRP140KA2	PUHZ-ZRP140KA2	PUHZ-ZRP140KA2		
Refrigerant <sup>(1)</sup>	R410A													
Power Supply	Outdoor power supply VKA-VHA-230/Single/50, YKA-400/Three/50													
Cooling	Capacity	Rated	kW											
	Min-Max	Rated	kW											
	Total Input	Rated	kW											
	EER	Rated	kW											
	Design load	Rated	kW											
Heating	Capacity	Rated	kW											
	Min-Max	Rated	kW											
	Total Input	Rated	kW											
	COP	Rated	kW											
	Design load	Rated	kW											

\*1 Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP. If leaked to the atmosphere, this appliance contains a refrigerant fluid with a GWP equal to 1975. This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be 1975 times higher than 1 kg of CO<sub>2</sub> over a period of 100 years. Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional. The GWP of R410A is 2088 in the IPCC 4th Assessment Report.

\*2 Energy consumption based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.

\*3 Optional air protection guide is required where ambient temperature is lower than -5°C. \*4 SEER and SCOP are based on 2009/125/EC: Energy-related Products Directive and Regulation(EU) No206/2012.

\*5 Joint pipe is required depending on installed refrigerant pipes, outdoor units and indoor units.

## PLA-M SERIES

### STANDARD INVERTER

Type	Inverter Heat Pump													
Indoor Unit	PLA-M35EA2	PLA-M50EA2	PLA-M60EA2	PLA-M71EA2	PLA-M100EA2	PLA-M100EA2	PLA-M125EA2	PLA-M125EA2	PLA-M140EA2	PLA-M140EA2	PLA-M140EA2	PLA-M140EA2		
Outdoor Unit	SUZ-KA35VA6	SUZ-KA50VA6	SUZ-KA60VA6	SUZ-KA71VA6	PUHZ-P100VA6	PUHZ-P100VA6	PUHZ-P125VA6	PUHZ-P125VA6	PUHZ-P140VA6	PUHZ-P140VA6	PUHZ-P140VA6	PUHZ-P140VA6		
Refrigerant <sup>(1)</sup>	R410A													
Power Supply	Outdoor power supply VA-VKA-230/Single/50, YKA-400/Three/50													
Cooling	Capacity	Rated	kW											
	Min-Max	Rated	kW											
	Total Input	Rated	kW											
	EER	Rated	kW											
	Design load	Rated	kW											
Heating	Capacity	Rated	kW											
	Min-Max	Rated	kW											
	Total Input	Rated	kW											
	COP	Rated	kW											
	Design load	Rated	kW											

\*1 Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP. If leaked to the atmosphere, this appliance contains a refrigerant fluid with a GWP equal to 1975. This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be 1975 times higher than 1 kg of CO<sub>2</sub> over a period of 100 years. Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional. The GWP of R410A is 2088 in the IPCC 4th Assessment Report.

\*2 Energy consumption based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.

\*3 Optional air protection guide is required where ambient temperature is lower than -5°C. \*4 SEER and SCOP are based on 2009/125/EC: Energy-related Products Directive and Regulation(EU) No206/2012.

\*5 Joint pipe is required depending on installed refrigerant pipes, outdoor units and indoor units.




**PLA-M SERIES**  
POWER INVERTER



Type		Inverter Heat Pump											
Indoor Unit		PLA-M35EA2	PLA-M50EA2	PLA-M60EA2	PLA-M71EA2	PLA-M100EA2	PLA-M100EA2	PLA-M125EA2	PLA-M125EA2	PLA-M140EA2	PLA-M140EA2	PLA-M140EA2	PLA-M140EA2
Outdoor Unit		PUH2-ZR2P35KA2	PUH2-ZR2P50KA2	PUH2-ZR2P60VHA2	PUH2-ZR2P71VHA2	PUH2-ZR2P100KA3	PUH2-ZR2P100KA3	PUH2-ZR2P125KA3	PUH2-ZR2P125KA3	PUH2-ZR2P140VKA3	PUH2-ZR2P140VKA3	PUH2-ZR2P140YKA3	PUH2-ZR2P140YKA3
Refrigerant <sup>**1</sup>		R410A											
Power Supply		Outdoor power supply											
Outdoor(V/Phase/Hz)		VKA-VHA:230/Single/50, YKA:400/Three/50											
Cooling	Capacity	Rated	kW	3.6	5.0	6.1	7.1	9.5	9.5	12.5	12.5	13.4	13.4
	Min-Max	kW	1.6 - 4.5	2.3 - 5.6	2.7 - 6.5	3.3 - 8.1	4.9 - 11.4	4.9 - 11.4	5.5 - 14.0	5.5 - 14.0	6.2 - 15.0	6.2 - 15.0	6.2 - 15.0
	Total Input	Rated	kW	0.833	1.416	1.747	1.868	2.230	2.230	3.869	3.869	4.393	4.393
	EER			4.32	3.53	3.49	3.80	4.26	4.26	3.23	3.23	3.05	3.05
	Design load	kW	3.6	5.0	6.1	7.1	9.5	9.5	12.5	12.5	13.4	13.4	13.4
Heating (Average Season)	Capacity	Rated	kW	4.1	6.0	7.0	8.0	11.2	11.2	14.0	14.0	16.0	16.0
	Min-Max	kW	1.6 - 5.8	2.5 - 7.3	2.8 - 8.2	3.5 - 10.2	4.5 - 14.0	4.5 - 14.0	5.0 - 16.0	5.0 - 16.0	5.7 - 18.0	5.7 - 18.0	5.7 - 18.0
	Total Input	Rated	kW	0.920	1.810	2.070	2.110	2.690	2.690	3.773	3.773	4.907	4.907
	COP			4.46	3.31	3.38	3.79	4.16	4.16	3.71	3.71	3.26	3.26
	Design load	kW	4.1	6.0	7.0	8.0	11.2	11.2	14.0	14.0	16.0	16.0	16.0

# PEAD SERIES

R32  
R410A

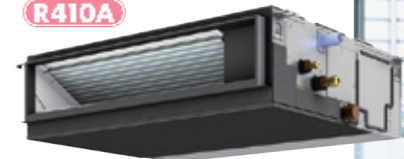

PEAD-M35/50/60/71/100/125/140JA2




Energy efficiency has been improved. A reduced electricity consumption contributes to a further reduction in operating cost. The thin body with a wide-ranged external static pressure of this series is the perfect answer for the air conditioning needs of buildings with minimum ceiling installation space.

## ErP Lot-10 compliant, Achieving High Energy Efficiency



The shape of fan wing and casing is improved to provide more smooth air flow, increasing the operation efficiency. All models under 12kW(M35-M100) are complied with ErP Lot 10 and energy rankings of A++ for cooling and A+ for heating. This contributes to a reduction in the cost of annual electricity.

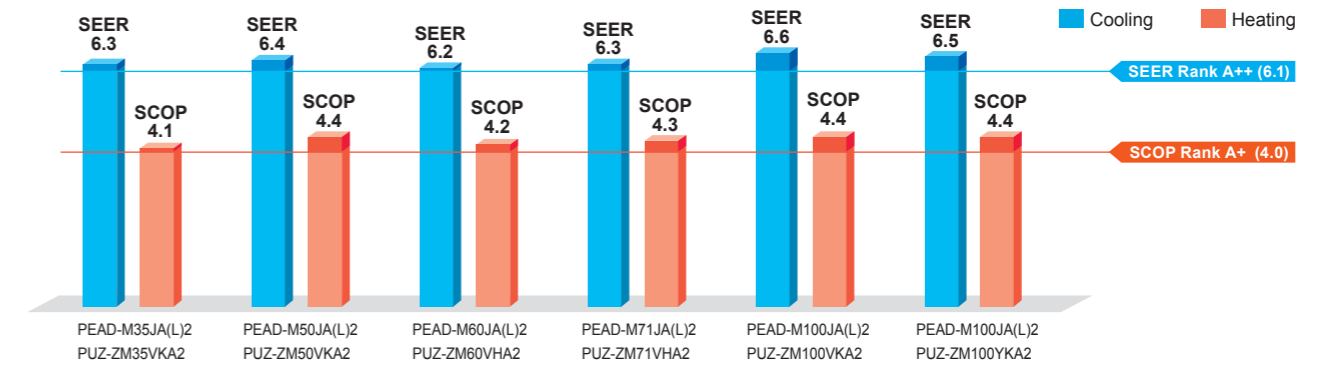

<sup>\*\*1</sup> Refrigerant leakage contributes to climate change. Refrigerant with lower global warming potential (GWP) would contribute less to global warming than a refrigerant with higher GWP, if leaked to the atmosphere. This appliance contains a refrigerant fluid with a GWP equal to 1975. This means that if 1 kg of this refrigerant fluid would be leaked to the atmosphere, the impact on global warming would be 1975 times higher than 1 kg of CO<sub>2</sub>, over a period of 100 years. Never try to interfere with the refrigerant circuit yourself or disassemble the product yourself and always ask a professional. The GWP of R410A is 2088 in the IPCC 4th Assessment Report.  
<sup>\*\*2</sup> Energy consumption based on standard test results. Actual energy consumption will depend on how the appliance is used and where it is located.  
<sup>\*\*3</sup> Optional air protection guide is required where ambient temperature is lower than -5°C.  
<sup>\*\*4</sup> SEER and SCOP are based on 2009/125/EC:Energy-related Products Directive and Regulation(EU) No206/2012.  
<sup>\*\*5</sup> Joint pipe is required depending on installed refrigerant pipes, outdoor units and indoor units.

## Compact Indoor Units

The height of the models from 35-140 has been unified to 250 mm, which makes installation in low ceiling with minimal clearance space possible.


## Selectable Static Pressure Levels

External static pressure conversion can be set up to five levels. Capable of being set to a maximum of 150 Pa, units are applicable to a wide range of building types.

## Drain Pump is Optionally Selectable

The line-up consists of two types: models with or without a built-in drain pump, thus allowing more freedom in piping design.

- PEAD-M JA2 ▶ Built-in drain pump
- PEAD-M JAL2 ▶ No drain pump

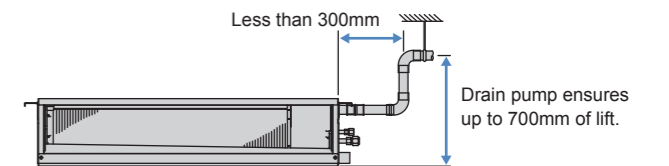

## Connectable to Plasma Quad Connect

The optional Plasma Quad Connect MAC-100FT-E can be installed on the indoor unit's air inlet side. For installation, PQ attachment or PQ box is required.